



## Independent Protection Co., Inc.

1607 South Main St.


Goshen, IN. 46526

574.533.4116 or 1.800.860.8388

Fax: 574.534.3719

info@ipclp.com www.ipclp.com

UL Listing No. E10913

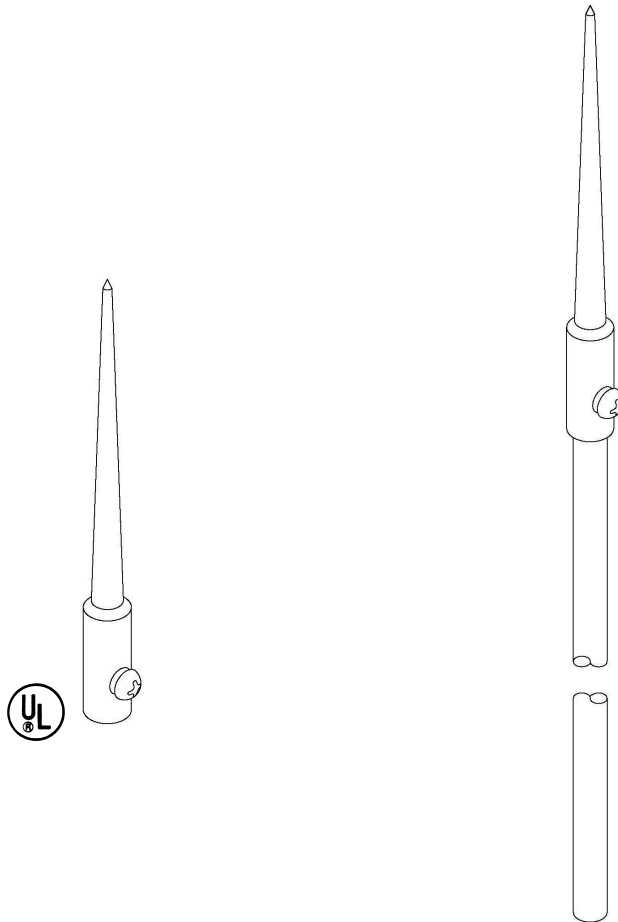

**255**

### Tin Coated Copper Chimney Air Terminal

For use with 3/8" notched rod. Strike termination device has set screw and approximately 4-3/4" in length.

Wt. .06 lbs. each.